

TARM USA Inc.


FIELD WIRING DIAGRAM

Rev. 7-6-07

NOTE:

All wiring must comply with current National Electrical Code and any other applicable codes. Refer to schematic included with panel or page 25 in the installation manual. 120 volt line voltage wiring shall be a code-approved type 14 gauge minimum. Low voltage wiring shall be 18 or 20 gauge thermostat wire.

For TARM EXCEL boiler control panel when heat storage tank is being used.

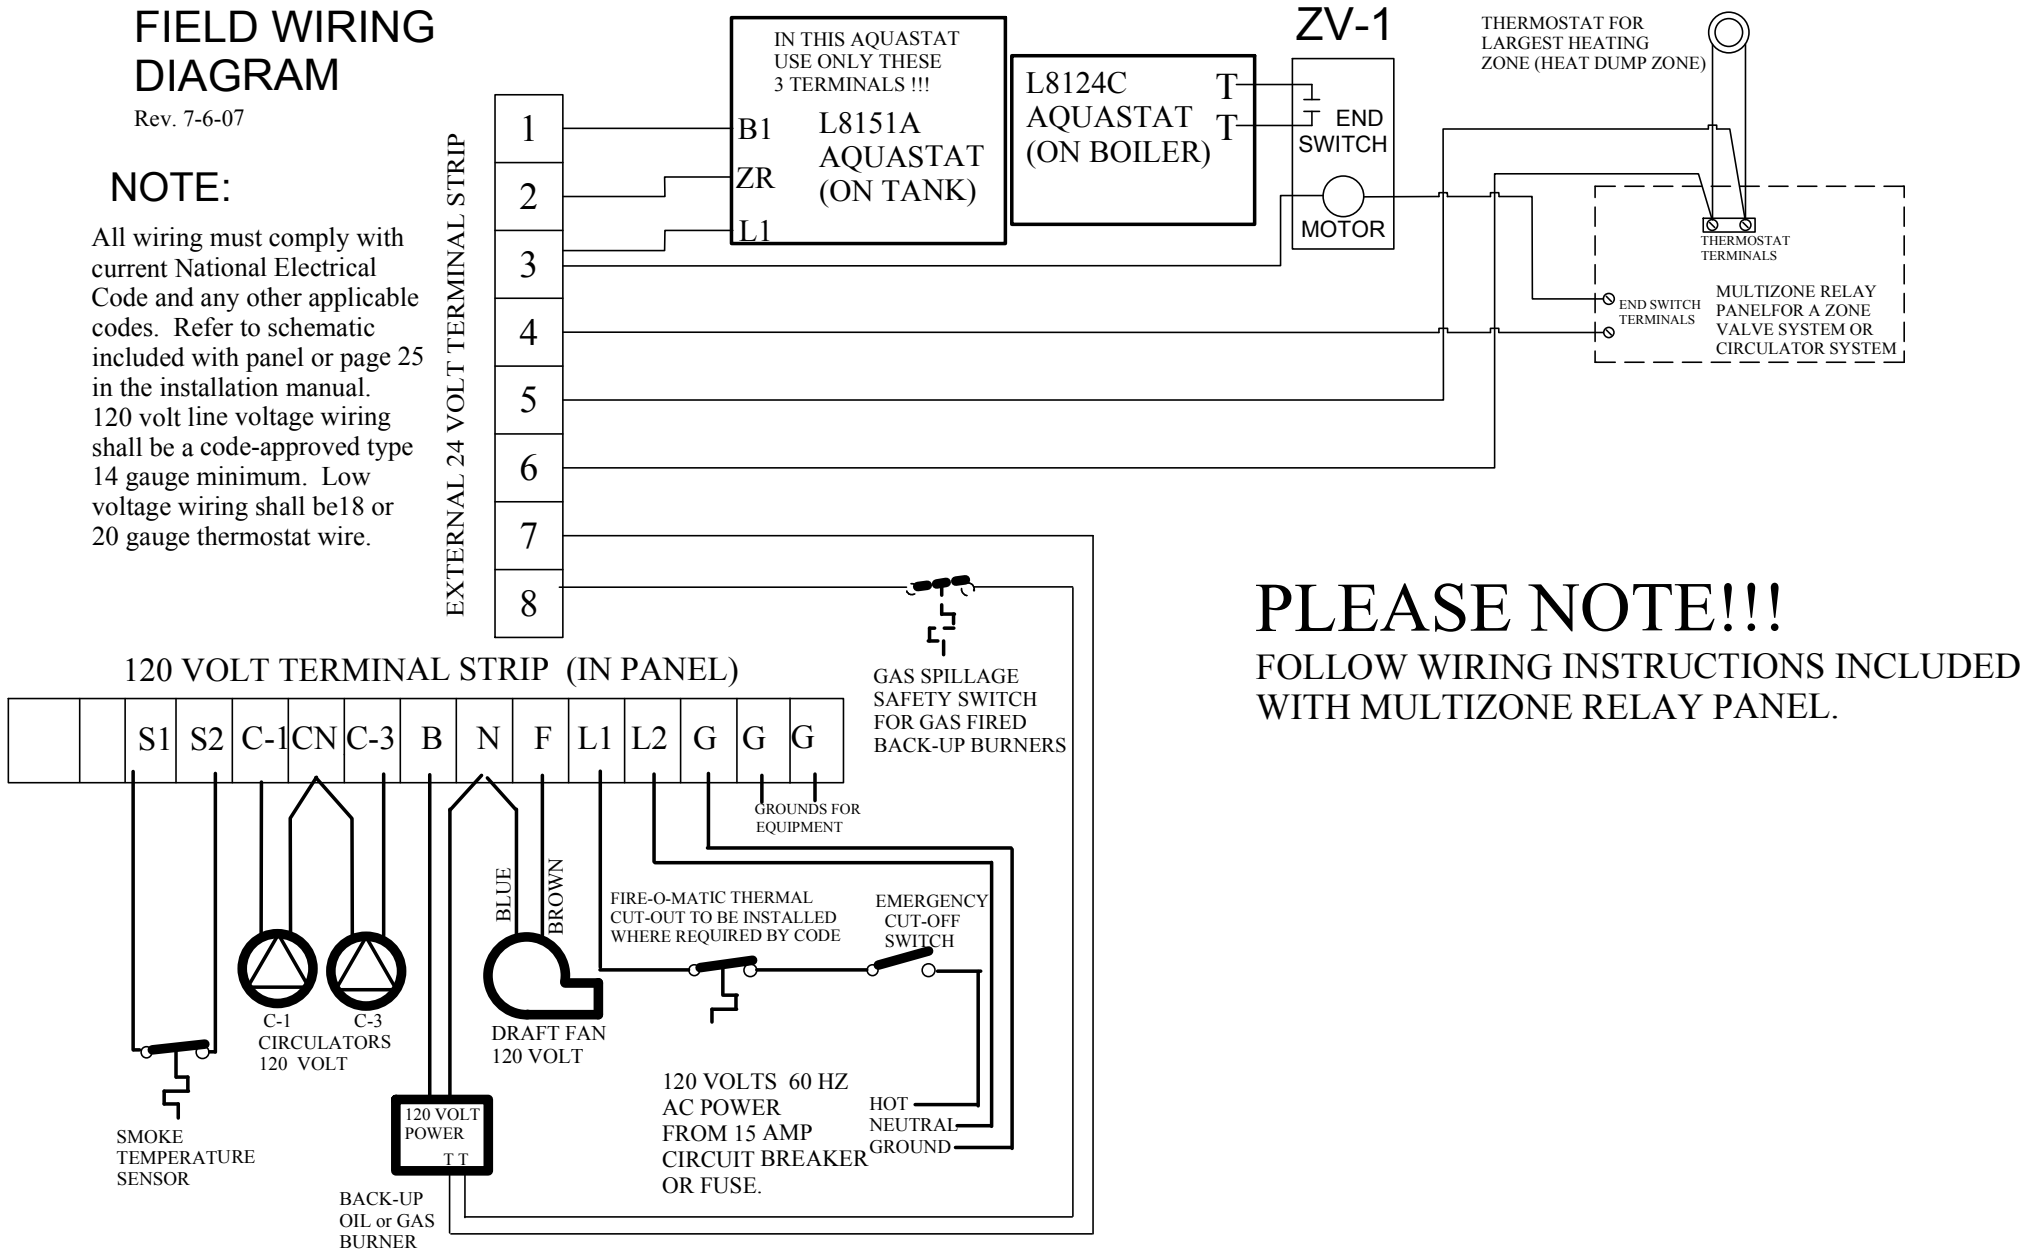

PLEASE NOTE!!!

FOLLOW WIRING INSTRUCTIONS INCLUDED WITH MULTIZONE RELAY PANEL.