

Tarm USA, Inc  
5 Main Street  
Lyme, NH 03768

**Tarm Piping Layout Concept Diagram**

**Single Boiler Installation With Circulators  
and Heat Storage System**

Drawn by: TSP

Date  
1-31-2008

DWG NO  
E

REV  
4

Checked by:

SCALE  
N/A

SHEET  
1 OF 1

**Notes:**


TV-1 Valve-Termovar 4440 Thermostatic Valve or Equivalent.  
TV-2 Valve-Termovar 6440 Diverting Valve or Equivalent.  
A1 Aquastat- Honeywell L4006B or Equivalent (Solo Plus Only).

**C-3 and C-1 Circulator Sizing (multi-speed circulator recommended):**

2-120' coils-Taco 007 or Equivalent.  
2-180' coils-Taco 010 or Equivalent.  
3-180' coils-Taco 010 or Equivalent.

**Symbol Key**

- Ball Valve
- Check Valve
- Weighted Check Valve
- Pressure Relief Valve
- Motorized Zone Valve
- Pressure Reducing Valve
- Differential Pressure Bypass
- Air Separator
- Circulator (w/isolation flanges)
- Boiler Drain
- Union
- Backflow Preventer
- Termovar Valve

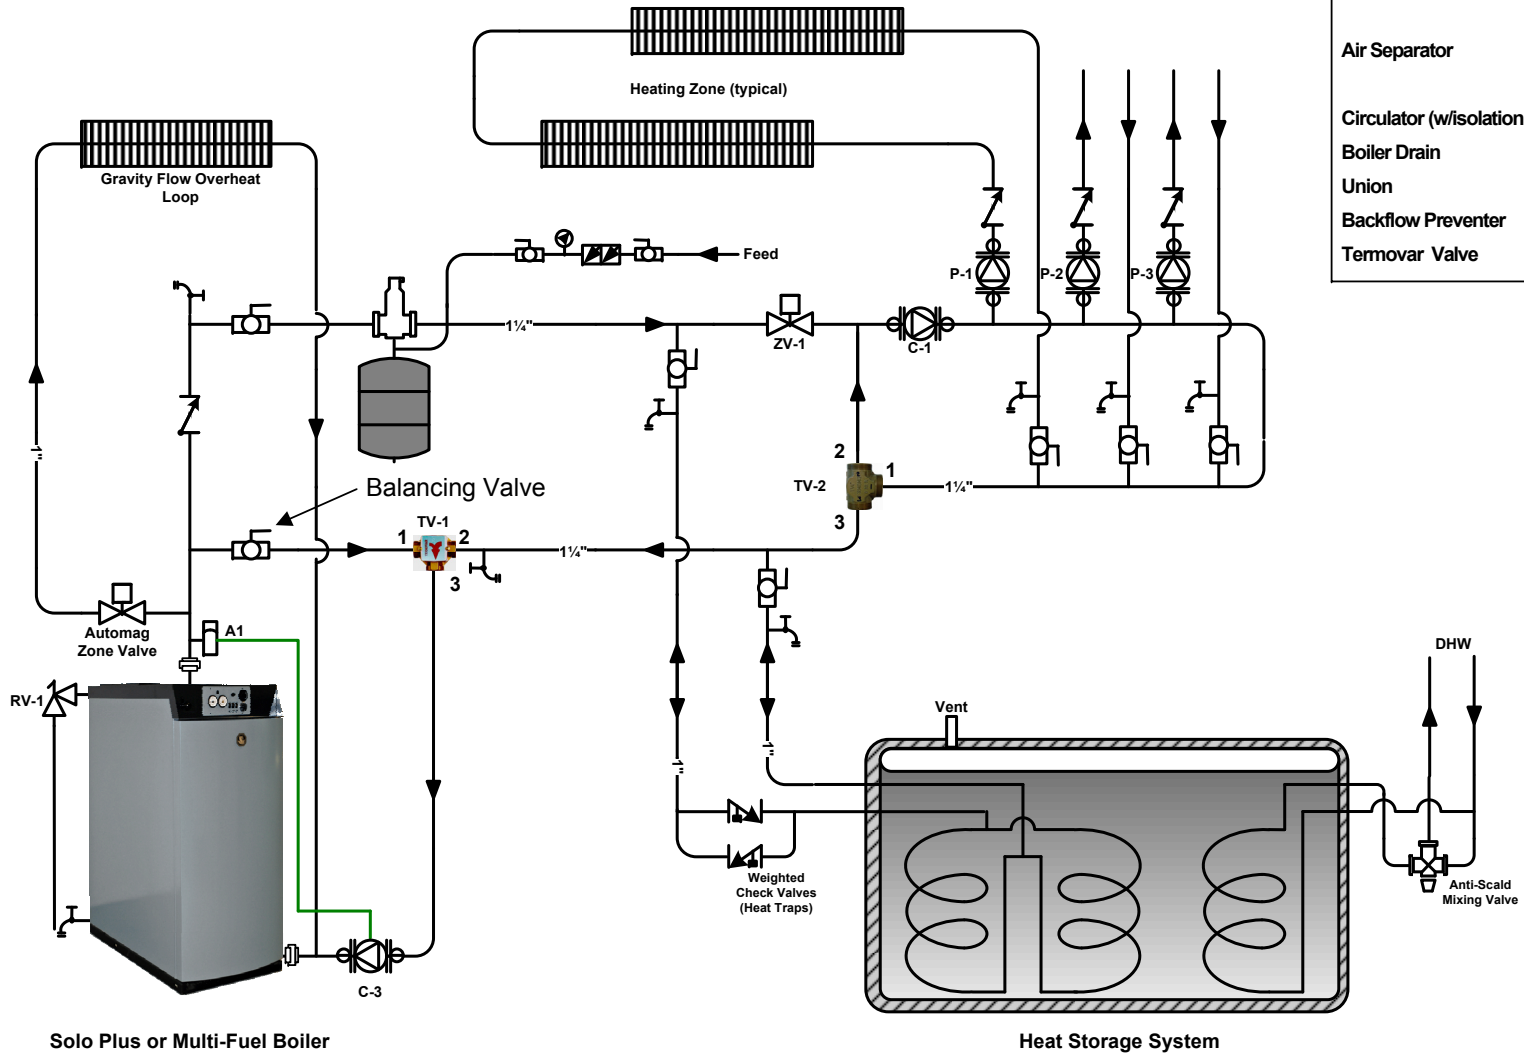

**Solo Plus or Multi-Fuel Boiler**

**Heat Storage System**

Note: This is only a concept drawing. Final design, installation and code compliance details are the responsibility of the designer/installer of the system.