

Tarm USA, Inc
5 Main Street
Lyme, NH 03768

Tarm Piping Layout Concept Diagram

Solo Plus 60 Boiler Installation With Circulators
and Heat Storage System

Drawn by: TSP

Date
1-31-2008

DWG NO
E60

REV
3


Checked by:

SCALE
N/A

SHEET
1 OF 1

Symbol Key

- Ball Valve
- Check Valve
- Weighted Check Valve
- Pressure Relief Valve
- Motorized Zone Valve
- Pressure Reducing Valve
- Differential Pressure Bypass
- Air Separator
- Circulator (w/isolation flanges)
- Boiler Drain
- Union
- Backflow Preventer
- Termove AF Valve

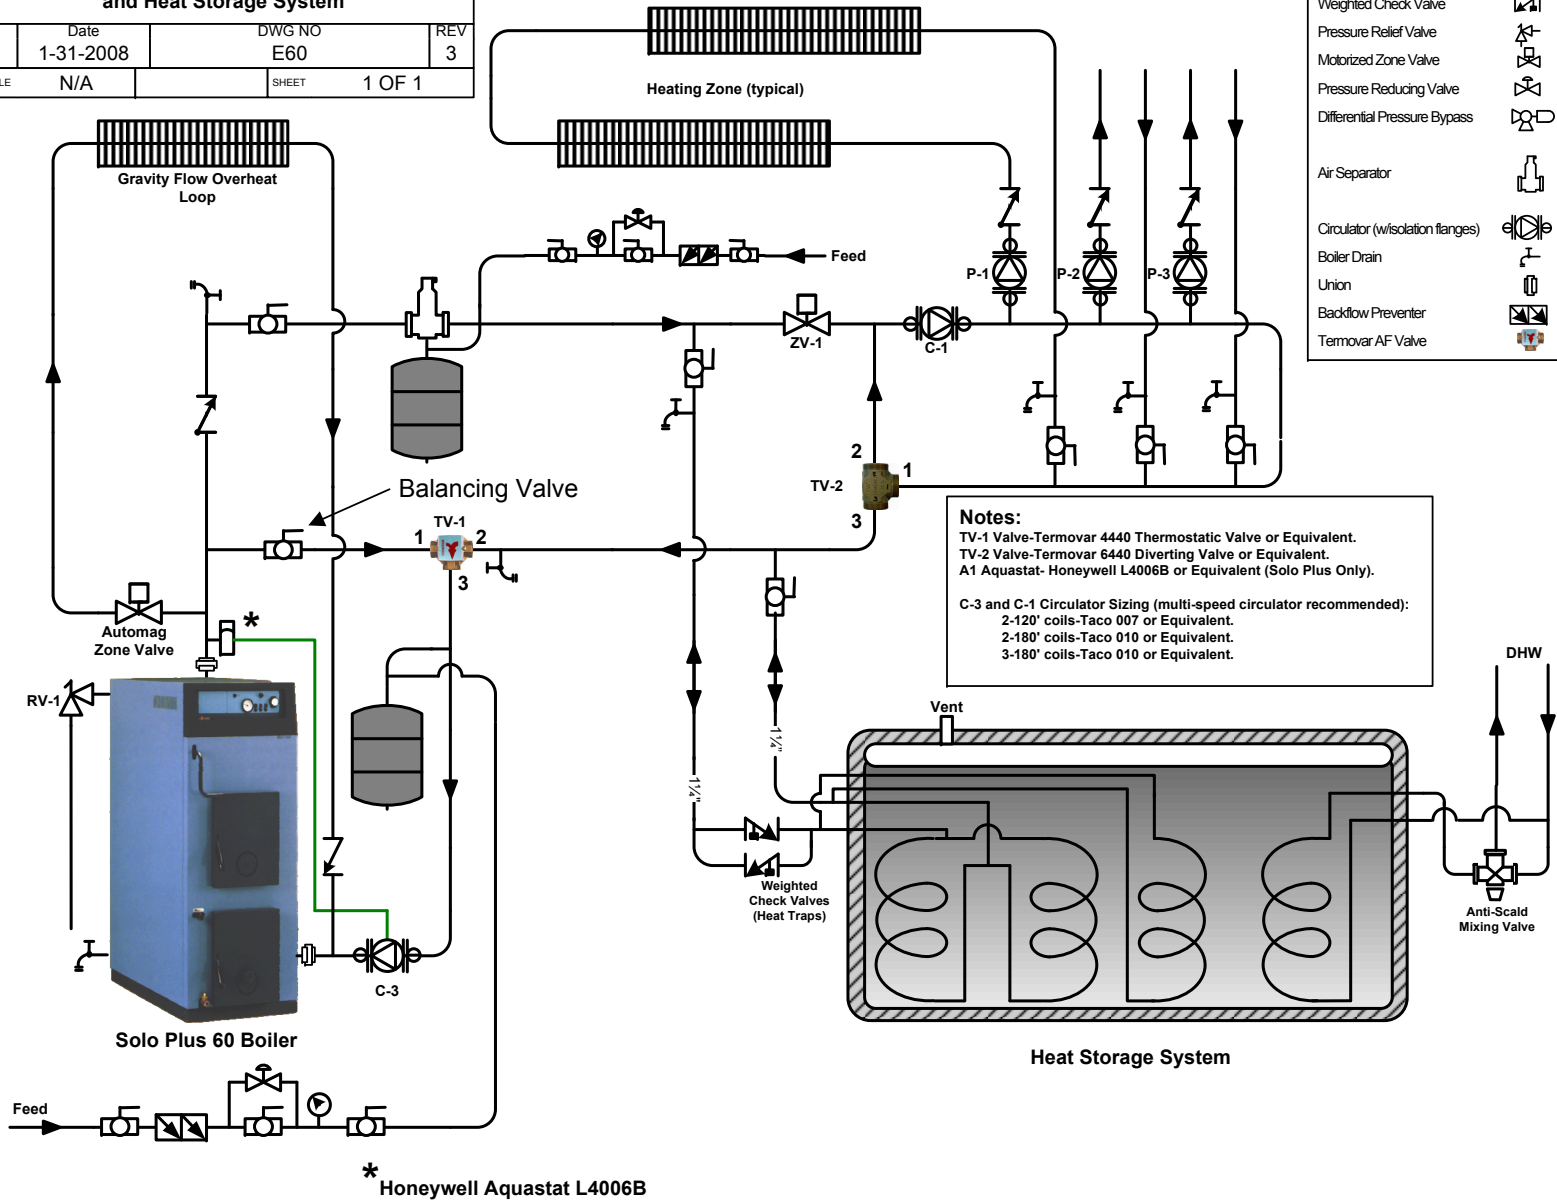

Notes:
TV-1 Valve-Termovear 4440 Thermostatic Valve or Equivalent.
TV-2 Valve-Termovear 6440 Diverting Valve or Equivalent.
A1 Aquastat- Honeywell L4006B or Equivalent (Solo Plus Only).

C-3 and C-1 Circulator Sizing (multi-speed circulator recommended):
2-120' coils-Taco 007 or Equivalent.
2-180' coils-Taco 010 or Equivalent.
3-180' coils-Taco 010 or Equivalent.

Note: This is only a concept drawing. Final design, installation and code compliance details are the responsibility of the designer/installer of the system.